Vertical Cable Manager (AR7588) Installation

Inventory

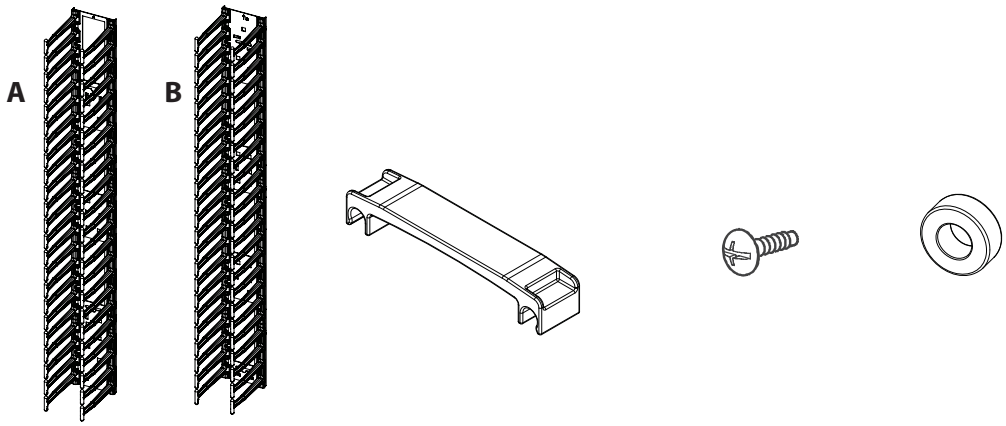

QTY	1	1	6	4	4

Adjust the vertical mounting rails and remove all hole covers and plugs

Note: If installing in rear of enclosure, move or remove vertical 0 U accessory channel.

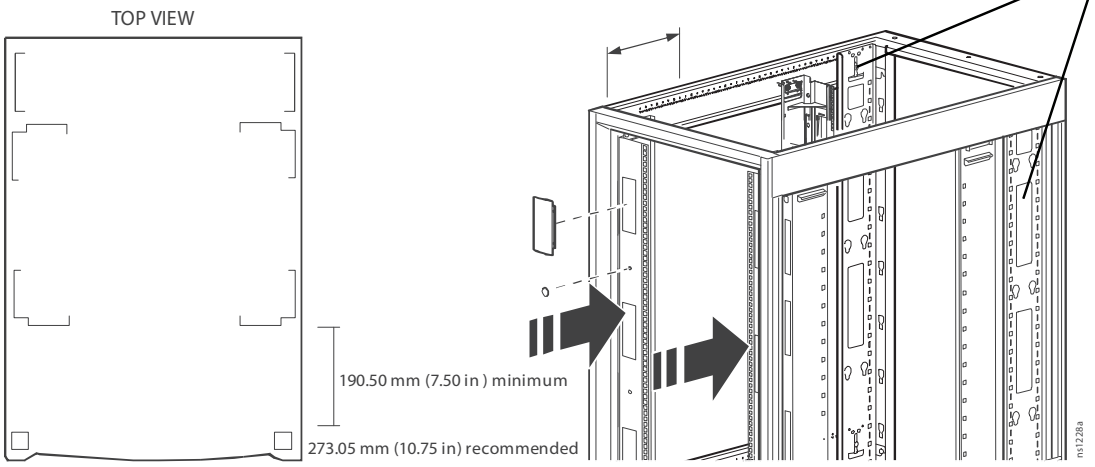

Identify the mounting slots

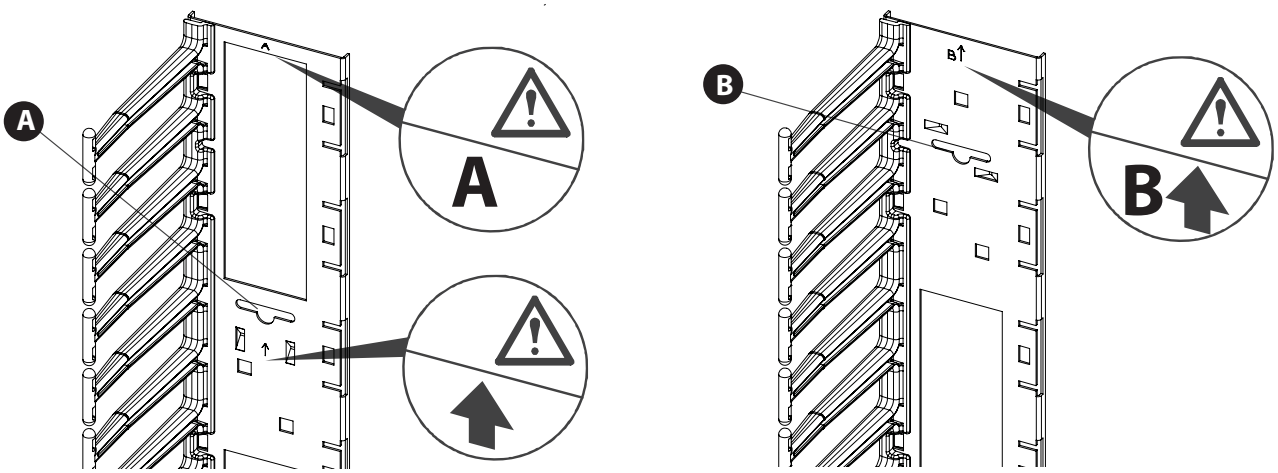

NetShelter 48 U Installation

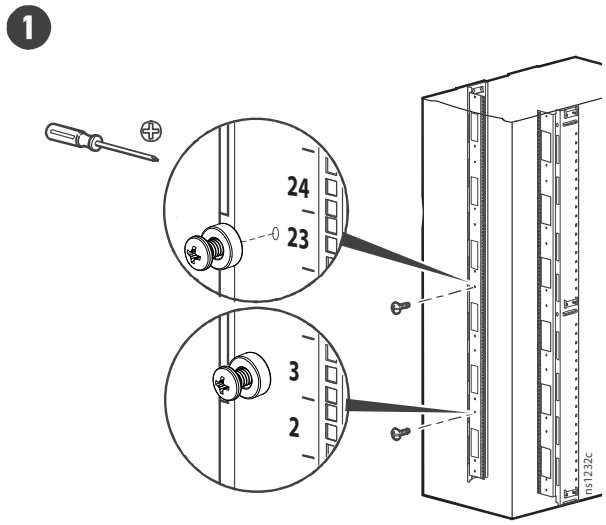

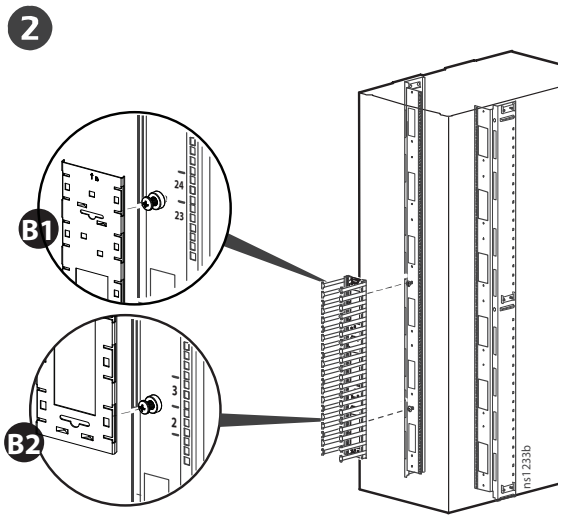

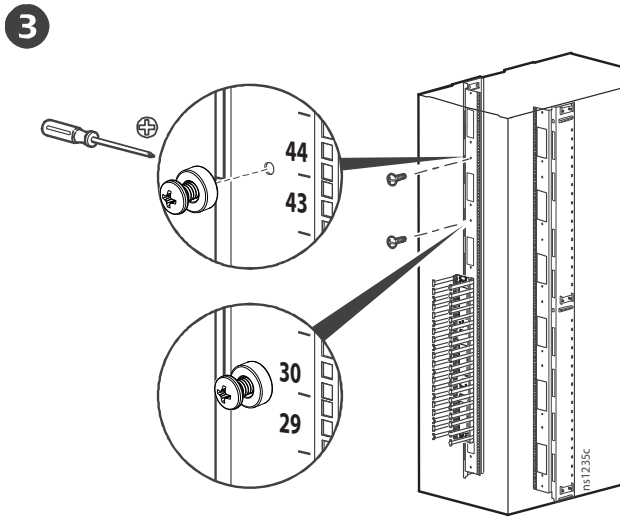

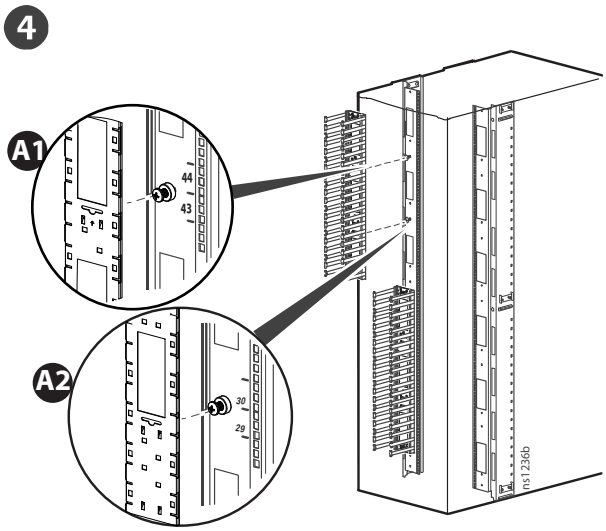

Vertical Cable Manager—Installation

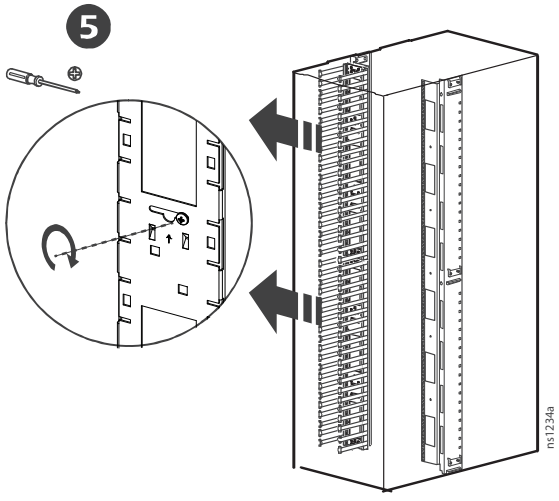

Attach the cable retainers

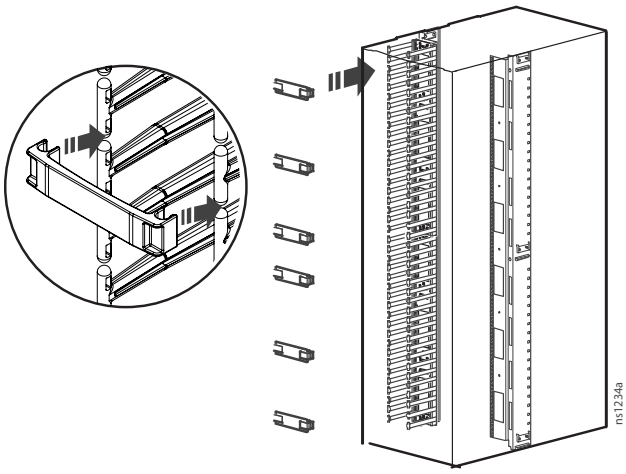

Customer support and warrant y information is available at the APC Web site, **www.apc.com**.

© 2012 APC by Schneider Electric. APC, the APC logo are owned by Schneider Electric Industries S.A.S.
All other trademarks are property of their respective owners.

990-4850
11/2012